

USNS GEN 10/11/1969DATE 11/26/69ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING <i>Two 800000</i> <i>Hot Room</i>	11-25-69	4 HRS.	100-100000-1.5 meg. PC 1.5 meg.
CARGO WINCHES	11-25-69	✓	3 and 4 - 1000
ANCHOR WINDLASS <i>0.4</i> <i>Tested</i>	11-26-69	30 minutes	over 15 meg.
CAPSTAN <i>0.4</i> <i>Tested</i>	11-26-69	30 minutes	over 15 meg.
FIRE ALARMS <i>Tested</i>	11-26-69	30 minutes	over 15 meg.
EXTEN. BATTERIES	11-25-69		0.8
DIESEL BATTERIES	11-25-69		0.8
FIRE PUMP BATTERIES	11-25-69		2.5
DIESEL GENERATORS <i>Tested</i>	11-26-69	2 HRS	15 00000
LAUNDRY SUPPLY <i>0.4</i> <i>Tested</i>	11-28-69	30 minutes	2 00000
RECTIFIERS			

Signature


 Electrician

USNS GEN

JOHN POPE

DATE

10/27/68ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	10-27-68	4 HRS	Wegel 800K I-2-M R-2 Megs
CARGO WINCHES	10-29-68		#5 - 600K #6 - 800K
ANCHOR WINDLASS	10-29-68	1 HR	
CAPSTAN	10-29-68	1 HR	#1 1-Meg #2 15-Megs
FIRE ALARMS	Daily	Tested	
EMERG. BATTERIES	10-27		OK
DIESEL BATTERIES	10-27		OK
FIRE PUMP BATTERIES	10-27	YRUP 1/2 HR	OK
DIESEL GENERATORS	10-29	2 HRS	with Load 130 Amps
LABORATORY SUPPLY	Wegel only		
RECTIFIERS	Wegel only		

Signature

John Pope

Electrician

USNS GEN

POPE (TOP 110)

DATE

11-20-69

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	10-20-69	4 Hrs	Coil 1-Meggs P41 coil 2-Meggs
CABLE WINCHES	10-24-69	1 HR	#5 600K #6 800K
ANCHOR WINDLASS	10-22-69	1 HR	6 - Meggs
CAPSTAN	10-22-69	1 HR	#1 1-Meggs #2 -15-Meggs
FIRE ALARMS	10-20-69	DAILY	
EMERG. BATTERIES	10-20-69		OK
DIESEL BATTERIES	10-20-69		OK
FIRE PUMP BATTERIES	10-20-69		OK
DIESEL GENERATORS	10-20-69	1/2 Hr	
LAUNDRY SUPPLY	10-20-69	ONLY	
RECTIFIERS	10-20-69	DAILY	POPE on ship power

Signature

Electrician

USNS GEN

John Pope

DATE

11/12/69ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	11/17/69	4 HRS	M-COIL-1 mags I & P COIL 2-mags
CARGO WINCHES	11/29/69		
ANCHOR WINDLASS	11/19/69		
CAPSTAN	11/19/69		
FIRE ALARMS	DAILY	Tested	
EMERG. BATTERIES	11/17/69		OK
DIESEL BATTERIES	11/17/69		OK
FIRE PUMP BATTERIES	11/17/69		OK
DIESEL GENERATORS	11/19/69		
LANDRY SUPPLY	Weight only		
RECTIFIERS	Weight only		
POPE on SHIP Power #2 Gen. on Service			

Signature

E. Shuler
Electrician

USNS GEN

John Pope


DATE

10-Nov. 69ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	11/10/69	4 HRS	M-coil 1-Meggs I-2-Meggs P-2-Meggs
CARGO WINCHES	11/14/69		#5-600K #6-800K
ANCHOR WINDLASS	11/12/69		6-Meggs
CAPSTAN	11/12/69		#1-14-Meggs #2-15-Meggs
FIRE ALARMS	DAILY Tested		
EMERG. BATTERIES	11/10/69		OK
DIESEL BATTERIES	11/10/69		OK
FIRE PUMP BATTERIES	11/10/69		OK
DIESEL GENERATORS	11/12/69	1/2 HR	
LABORATORY SUPPLY	WEIGEL ONLY		
RECTIFIERS	DAILY WEIGEL ONLY		

U.S.N.S. John Pope SHIP POWER #2 Gen. ON SERVICE

Signature

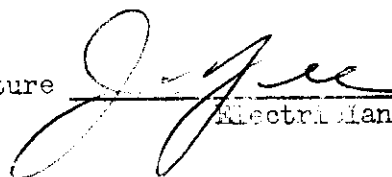

Electrician

USNS GEN


JOHN POPE

DATE

11-3-69ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	11/3/69	4 HRS.	M-coil 1-meg PCOIL 1 COIL 2 COIL
CARGO WINCHES	11/7/69		#5 600-#6 800
ANCHOR WINDLASS	11/5/69		5-meggers
CAPSTAN	11/5/69		#1 1-meg #2
FIRE ALARMS	Daily Tested		
EMERG. BATTERIES	11/3/69		OK
DIESEL BATTERIES	11/3/69		OK
PUMP BATTERIES	11/3/69		OK
DIESEL GENERATORS	11/5/69	1/2 Hr.	
LAUNDRY SUPPLY	Weigel ONLY		
RECTIFIERS	Daily Tested		

Signature

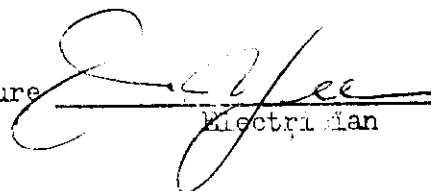

Electrician

USNS GEN

POPE (TAP 110)

DATE

10-13-70-10-17-69

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	10-13-69	4 HRS	M-814-Megger I.P. coil 2-Megs
CARGO WINCHES	10-17-69	1 HR.	#5 600K #6 800K
ANCHOR WINDLASS	10-15-69	1 HR.	6-Megger
CAPSTAN	10-15-69	1 HR.	#1 1-Megger #2-15-Megs
FIRE ALARMS	10-13-69	PAULY	
EMER. BATTERIES	10-13-69		OK.
DIESEL BATTERIES	10-13-69		OK.
FIRE PUMP BATTERIES	10-13-69	OK	OK FWD ONLY
DIESEL GENERATORS	10-15-69	1/2 HR	6-Megger
LAUNDRY SUPPLY	WEIGEL	ONLY	
RECTIFIERS	DAILY		

Signature

Electrician

USNS GEN

JOHN POPE (TAP 110)

10-6-70 10-10-69


DATE

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	10-6-69	4 HRS	2 MEGS -
CARGO WINCHES 1 TO 8	10-10-69	1 HR	#1-2M #3-400K #5-600K #2-3M #4-2M #6-800K
ANCHOR WINDLASS	10-8-69	1 HR	4 MEGS #7-2M #8-200K
CAPSTAN	10-8-69	1 HR	#1 1 MEG #2 8 MEGS
FIRE ALARMS	DAILY		
ENGINE BATTERIES	10-6-69	OK	
DIESEL BATTERIES	10-6-69	OK	
FIRE PUMP BATTERIES	10-6-69	#1 FIRE PUMP OK	#2 NEEDS NEW BATTERY '68
DIESEL GENERATORS	10-8-69	1/2 HR	6 MEGS
LAUNDRY SUPPLY	WEIGEL ONLY		
RECTIFIERS	DAILY		

TESTED ALL BILGE AIR VALVES AND #1 FIRE PUMP
10-10-69

Signature

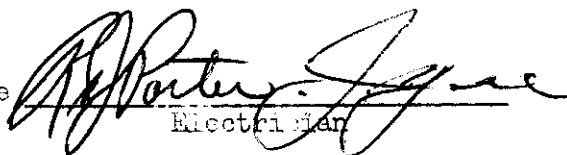

Electrician

USNS GEN

JOHN POPE (TAP110)

9-29-10-3-69

DATE

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	9-29-69	4 HRS	
CABLE WINCHES	YARD OVERHAUL		
ANCHOR WINDLASS	10-1-69	1 HR	6 - MEGGS.
CAPSTAN	10-1-69	1 HR.	#1 I MEGGS #2 15 MEGGS
FIRE ALARMS	DAILY		
EMERG. BATTERIES	9-29-69	OK	
DIESEL BATTERIES	9-29-69	OK	
FIRE PUMP BATTERIES	9-29-69	FWD-OK	AFTER-NEEDS NEW BATTERIES
DIESEL GENERATORS	10-1-69		6 MEGGS -
INVENTORY SUPPLY	WEAGEL ONLY		
RECTIFIERS	NO TEST		

Signature

Electrician

USNS GEN

DATE _____

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	28 SEPT 69	4 HRS	2 MEGGS
CARGO WINCHES	YARD OVERHAUL		
ANCHOR WINDLASS	3 SEPT 69	1 HR	7 MEGGS
CAPSTAN	3 SEPT 69	1 HR	#1 1.5 MEGGS #2 20 MEGGS
FIRE ALARMS	DAILY		
EMERG. BATTERIES	25 SEPT 69	OK	
DIESEL BATTERIES	25 SEPT 69	OK	
FIRE PUMP BATTERIES	25 SEPT 69	FWD OK	AFTER NEEDS NEW BATTERIES
DIESEL GENERATORS	30 SEPT 69	1/2 HR	6 MEGGS
LAUNDRY SUPPLY	WEIGEL ONLY		
RECTIFIERS	NOT TEST		

TESTED ALL BIGE AIR VALVES 9-3-69

TEST RUN #1 EMERG. DIESEL FIRE PUMP - 9-3-69.

Signature

Electri star

USNS GEN

POPE (TAP/10)

9-22-9-26-69

DATE

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	9-22-69	4 HRS	2 meggs
CARGO WINCHES	9-26-69		
ANCHOR WINDLASS	9-24-69	1 HR	6- meggs.
CAPSTAN	9-24-69	1-HR	#1 1 meggs #2 1/5 meggs
FIRE ALARMS	DAILY		
EMERG. BATTERIES	9-22-69	OK	
DIESEL BATTERIES	9-22-69	OK	
FIRE PUMP BATTERIES	9-22-69	OK	AFTER FIRE PUMP ^{NEEDS NEW} BATTIES
DIESEL GENERATORS	9-22-69	24 HRS	6 meggs
LAUNDRY SUPPLY	WEIGER ONLY		
RECTIFIERS	NO TEST		

Signature



Electrician

USNS GEN

John Pope (TAP10)

DATE

15-19 April 1969

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	9-15-69	4 HRS	2 MEGGS.
CARGO WINCHES	YARD OVERHAUL		
ANCHOR WINDLASS	9-18-69	1 HR	5 - MEGGS
CAPSTAN	9-18-69	1-1 HR	#1, 1.5 MEGGS #2, 20 MEGG
FIRE ALARMS	DAILY		
EMERG. BATTERIES	9-15-69	OK	
DIESEL BATTERIES	9-15-69	OK	
FIRE PUMP BATTERIES	9-15-69	#1 F.P. OK	#2 F.P. NEEDS NEW BATT.
DIESEL GENERATORS	9-18-69	1/2 HR	6 MEGGS
LAUNDRY SUPPLY	WEIGEL ONLY		
RECTIFIERS	NO TEST		

Signature



Electrician

USNS GEN

JOHN POPE (TAP110)


SEPT 8 12-1969
DATEROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	9-8-69	4 HRS.	2 MEGGS.
CARGO WINCHES	YARD OVERHAUL.		
ANCHOR WINDLASS	9-10-69	1 HR	6 - Meggs.
CAPSTAN	9-10-69	1 HR	#1 1.5-M. #2 - 20-M.
FIRE ALARMS	DAILY		
EMERG. BATTERIES	9-8-69	11:60	ON CHARGE
DIESEL BATTERIES	9-8-69	OK	
FIRE PUMP BATTERIES	9-8-69	FWD OK	AFTER NEEDS NEW BATTERIES
DIESEL GENERATORS	9-10-69	1/2 HR	6 MEGGS.
LAUNDRY SUPPLY	WEIGEL-ONLY		
RECTIFIERS	NO TEST.		

TESTED ALL BILGE AIR VALVES

TEST RUN #1 DIESEL FIRE PUMP.

Signature

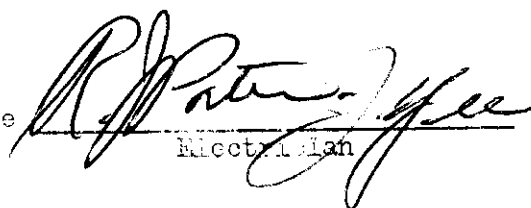
Electrician

USNS GEN

JOHN POPE (TAP 110)

DATE


25 AUG 1964

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	25 AUG 64	4 HRS	2 MEGGS
CARGO WINCHES	UNDER-REPAIR YARD		
ANCHOR WINDLASS	27 AUG 64	1 HR	6 MEGGS
CAPSTAN	27 AUG 64	1 HR	#1 1 MEGGS #2 15 MEGGS
FIRE ALARMS	DAILY —		
EMERG. BATTERIES	25 AUG 64	OK	
DIESEL BATTERIES	25 AUG 64	OK	
FIRE PUMP BATTERIES	25 AUG 64	OK	AFTER FIRE PUMP BATT. ^{OUT FOR REPAIR}
DIESEL GENERATORS	27 AUG	2 HRS	6 MEGGS
LAND OIL SUPPLY	WEIGEL ONLY		
RECTIFIERS	YARD		

Signature

Electrician

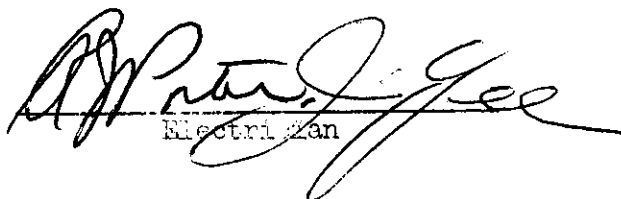

USNS GEN PIPE (TAP 110)

DATE 18 AUG 1969

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	18 AUG 1969	4 HR	2 MEGGS.
CARGO WINCHES	18 AUG 69	1 HR	# 5 4 MEGGS. # 6 6 MEGGS.
ANCHOR WINDLASS	18 AUG	1 HR	6 MEGGS
CAPSTAN	18 AUG	1 HR	#1 - 1 MEGGS #2 - 15 MEGGS.
FIRE ALARMS		DAILY	
EMERGENCY BATTERIES	18 AUG 69	OK	
DIESEL BATTERIES	18 AUG 69	OK	
FIRE PUMP BATTERIES	18 AUG 69	OK	#2 FIRE PUMP OUT FOR REPAIR
DIESEL GENERATORS	28 AUG 69	1/2 HOUR	6 MEGGS
LAUNDRY SUPPLY		WEIGEL ONLY	
RECTIFIERS		DAILY	

Signature

~~Electrician~~

USNS GEN JOHN POPE (TAP118) DATE 11 AUG-1969

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	8-11-69	4 HR.	1 MEGGS
CARGO WINCHES	8-15-69	1 HR	#5-4 MEGGS #6-6 MEGGS
ANCHOR WINDLASS	8-13-69	1 HR	6- MEGGS
CAPSTAN	8-13-69	1 HR	#1-5 MEGGS #2-20 MEGGS
FIRE ALARMS	DAILY		
ENGINE BATTERIES	8-11-69	OK.	
DIESEL BATTERIES	8-11-69	OK	
FIRE PUMP BATTERIES	8-11-69	FWD PUMP OK	AFTER PUMP NO GOOD.
DIESEL GENERATORS	8-13-69	1/2 HR.	6 MEGGS
LAUNDRY SUPPLY	WEIGHT ONLY		
RECTIFIERS	DAILY		

Signature

Raymond [Signature]
Electrician

USNS GEN

Weigel

AVG 1969

DATE 11-15ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DE-BOUSSING	8/11/69	1	C. 400M F.I. 10M F.P. 65M #1. 75K F.I. 1M F.P. 800M #2. 1.50M #2. 200K #5. 6M #6. 62M
CARGO WINCHES	8/15	1	H. #1. #2. #5. #6.
ANCHOR WINDLASS	13 th	1	Cold 5M Hot 300K
CAPSTAN	13 th	1	#1 Hot 20M Cold 30M #2 20M 30M
FIRE ALARMS	Daily		
ENGINE BATTERIES	11 th		1240
DIESEL BATTERIES	11 th		1240
FIRE PUMP BATTERIES			
DIESEL GENERATORS	13 th	1	30 MEGS.
LAUNDRY SUPPLY	13 th		C. T1. 1M T11. 5M H. T1. 1.5M T11. 50M.
RECTIFIERS	Daily		

Signature

Archie B. C. Garrett

Electrician

USNS GEN

JOHN POPE (TAP110)


DATE 4 AUG. 1969

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	8-4-69	4 HRS	2 MEGGS
CARGO WINCHES	8-8-69	1 HR.	#5 4 MEGGS #6 6 MEGGS
ANCHOR WINDLASS	8-6-69	1 HR	6 MEGGS
CAPSTAN	8-6-69	1 HR	#1 1 MEGGS #2 15 MEGGS
FIRE ALARMS	DAILY		
EMERG. BATTERIES	8-4-69	OK	
DIESEL BATTERIES	8-4-69	OK	
FIRE PUMP BATTERIES	8-4-69	AFTER FIRE PUMP	
DIESEL GENERATORS	8-6-69	1/2 HR.	6 MEGGS
LAUNDRY SUPPLY	WEIGEL ONLY		
RECTIFIERS	DAILY		

TESTED ALL BILGE AIR VALVES TEST RUN #1
DIESEL FIRE PUMP 8-6-69

Signature

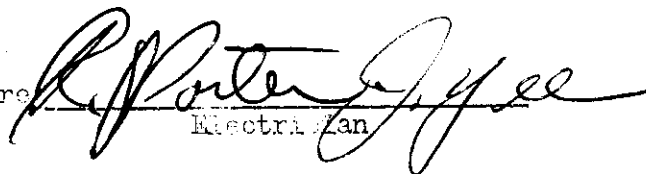

Electrician

USNS GEN

WEIGEL

DATE

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	4 th	4	M-600K FI-1M FP 1.5
CARGO WINCHES	8/6	1	COLD #1. 8M. HOT #1. 300K.
ANCHOR WINDLASS	8/6	1	COLD #1. 8M. HOT #1. 300K.
CAPSTAN	8/6	1	COLD #1. 100M. #2. 50M. HOT #1. 40M. #2. 40M.
FIRE ALARMS	DAILY		
ENGINE BATTERIES	4 th		1240 O.K.
DIESEL BATTERIES	4 th		1230 O.K.
FIRE PUMP BATTERIES			
DIESEL GENERATORS			
LAUNDRY SUPPLY	8/6	2	COLD T1. 900K T11. 15M. HOT T1. 800K T11. 40M.
RECTIFIERS	DAILY		

Signature

Archie B. O. Harriott
Electrician

USNS GEN

JOHN POPE (TAP110)

DATE


28 July 1969

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	7-28-69	4 HRS.	2 MEGGS
CARGO WINCHES	8-1-69	1 HR.	#56 MEGGS #68 MEGGS
ANCHOR WINDLASS	7-30-69	1 HR	6 - MEGGS
CAPSTAN	7-30-69	1 HR	#1 1 MEGGS #2 15 MEGGS
FIRE ALARMS		DAILY	
EMERG. BATTERIES	7-28-69	OK	
DIESEL BATTERIES	7-28-69	OK	
FIRE PUMP BATTERIES	7-28-69	OK	
DIESEL GENERATORS	7-30-69	2 HRS	8 MEGGS
LAUNDRY SUPPLY		WEIGEL ONLY	
RECTIFIERS		DAILY	

TESTED ALL BILGE AIR VALVES TEST RUN EMG.
DIESEL FIRE PUMP #1 7-30-69

Signature

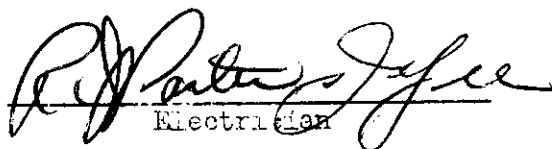

Electrician

USNS GEN

WEIGEL

DATE

JUL-AUG28-11969ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	7/28	4	COLD MEGGER. F15M F.P.M. HOT M10K. F1.15M. F.P.M. #1 25M. #5 6M.
CARGO WINCHES	8/1		#2 200K #1 6 12M.
ANCHOR WINDLASS	7/30		COLD #1 4M HOT #1 900K
CAPSTAN	7/30		COLD #1 75M. #2 100M. HOT #1 30M. #2 90M.
FIRE ALARMS	DAILY		
ENGINE BATTERIES	7/28		1270
DIESEL BATTERIES	7/28		1220
FIRE PUMP BATTERIES			
DIESEL GENERATORS			
LAUNDRY SUPPLY	7/30		COLD T1.25K T11. 125K. HOT T1.100K T11. 15M.
RECTIFIERS	DAILY		

Signature

Electrician

USNS GEN

DOPE (TAP 110)


DATE 22 JULY 1969

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	7-21-69	4 HRS	2 MEGGS
CARGO WINCHES	7-		#5 2 MEGGS - #6 6 MEGGS
ANCHOR WINDLASS	7-23-69	1 HR	6 MEGGS
CAPSTAN	7-23-69	1 HR	#1 1 MEGGS #2 16 MEGGS
FIRE ALARMS		DAILY	
EMER. BATTERIES	7-22-69	OK	
DIESEL BATTERIES	7-22-69	OK	
FIRE PUMP BATTERIES	7-22-69	OK	
DIESEL GENERATORS	7-23-69	OK	6 MEGGS
LAUNDRY SUPPLY		WELGEL ONLY	
RECTIFIERS		DAILY	

TESTED ALL BILGE AIR VALVES, TEST RUN EMERG DIESEL
FIRE PUMPS - 7-23-69

Signature

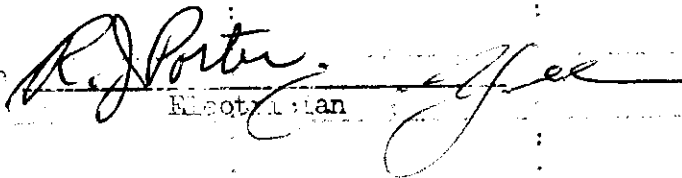

Electrician

USNS GEN _____

JULY
DATE 22-25/69ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	7/22	4	COLD M:300K F:1.5M F.P:1.5M HOT M:20K F:1.20M F.P:10K.
CARGO WINCHES		$\frac{1}{2}$	#1:20M #5:1M. #2:200K #6:15M.
ANCHOR WINDLASS	23rd	1	Cold 5M Hot 300K
CAPSTAN	23rd	1	*1-20M *2-30M.
FIRE ALARMS	DAILY		
EMER. BATTERIES	7/22		1240
DIESEL BATTERIES	7/22		1220
PUMP BATTERIES			
DIESEL GENERATOR	23rd	$\frac{1}{2}$	No load.
LAUNDRY SUPPLY	7/23		COLD T:100K T:11.5M. HOT T:3M T:11.30M
RECTIFIERS	DAILY		
I.C. BATTERIES	7/22-24		ADDED WATER CHARGING 0.800 - (1220 CHARGED)

Signature

Richard D. Garrett

Electrician

USNS GEN

PIPE (TAP 110)

DATE

14 July 1969

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	7/14/69	4 HRS	2 MEGGS
CABLE WINCHES	7/18/69	1/2 Hr.	#5 6-Meggs #2 20-Meggs
ANCHOR WINDLASS	7/16/69	1/2	6-Meggs
CAPSTAN	7/16/69	1/2	#1 1-Meggs #2 15-Meggs
FIRE ALARMS	7/14/69	OK	
EMERG. BATTERIES	7/14/69	OK	
DIESEL BATTERIES	7/14/69	OK	
FIRE PUMP BATTERIES	7/14/69	OK	
DIESEL GENERATORS	7/14/69		6-Meggs
LAUNDRY SUPPLY	7/14/69		WEIGER
RECTIFIERS	7/14/69		PAIR 1/2

TESTED ALL BILGE AIR VALVES TEST RUN
DIESEL EMERG. FIRE PUMPS #1 & 2 7-16-69

Signature



Electrician

USNS GEN

Weigel

DATE

7-18-69ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	14 th		Cold M-200K FI. 5M FPM Hot M-520K FI. 50M FPM
CARGO WINCHES	18 th	1/4	# 1-15M 5-2M 2-300K 6-10M
ANCHOR WINDLASS	16 th	1 hr	5 Megs
CAPSTAN	16 th		# 1-50M 2-30M
FIRE ALARMS	Daily		
EMERG. BATTERIES	14 th		Full Charge.
DIESEL BATTERIES	14 th		1.260 Added water & charged. 24 hours
FIRE PUMP BATTERIES			
DIESEL GENERATOR	17 th	1/2	No load.
LAUNDRY SUPPLY			
RECTIFIERS	Daily		

Signature

W. C. Brooks.

Electrician

USNS GEN

PIPE (TAP 110)


DATE

7 July 1969

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	7-7-69	4 HRS	2 MEGGS.
CARGO WINCHES	7-11-69	1 HR	#5 8 MEGGS #6 15 MEGGS
ANCHOR WINDLASS	7-9-69	1 HR	6- MEGGS
CAPSTAN	7-9-69	1 HR	#1 1 MEGGS #2 15 MEGGS
FIRE ALARMS	DAILEY		
EMERG. BATTERIES	7-7-69	OK	
DIESEL BATTERIES	7-7-69	OK	
FIRE PUMP BATTERIES	7-7-69	OK	
DIESEL GENERATOR	7-9-69	1/2 HR	6 MEGGS
LAUNDRY SUPPLY	WEIGEL ONLY		
RECTIFIERS	DAILEY		

Signature

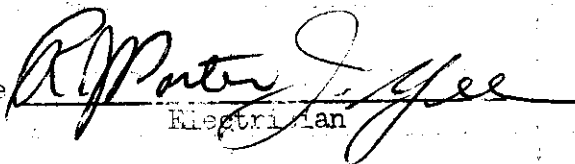

Electrician

USNS GEN

Weigel

DATE

7-7-67ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	7th	4	Hot M-500K FI-4M FP-1.5M Cold M-100K FI-800K FP-1M
CARGO WINCHES	11th		#1-5M #5-5M #2-300K #6-1M
ANCHOR WINDLASS	9th	1	5 Megs
CAPSTAN	9th	1	#1-50M #2-30M
FIRE ALARMS	Daily		
EMERG. BATTERIES	7th		OK - 12.1V
DIESEL BATTERIES:	7th	Low	Added water + 12.4V
FIRE PUMP BATTERIES			
DIESEL GENERATORS	7th	2hr	Under Load.
LAUNDRY SUPPLY	11th	1hr	T1-50K T11-3M
RECTIFIERS			

11th Diesel Batteries 12.40
 Added approx 10 gal water
 TS

Signature

W. C. Brooks

Electrician


USNS GEN POPE (TAP 116)DATE 30 June 1969ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	6-30-69	4 HRS	2 MEGGS
CABLE WINCHES	7-3-69	1 HR	#5-20 MEGGS #6-8 MEGGS
ANCHOR WINDLASS	7-2-69	1 HR	6 MEGGS
CAPSTAN	7-2-69	1 HR	#1-2 MEGGS #2-15 MEGGS
FIRE ALARMS	DAILEY		
EMERG. BATTERIES	6-30-69	OK	
DIESEL BATTERIES	6-30-69	OK	
FIRE PUMP BATTERIES	6-30-69	OK	
DIESEL GENERATORS	7-2-69		6 MEGGS.
LAUNDRY SUPPLY	WEIGER ONLY		
RECTIFIERS	DAILEY		

TESTED ALL AIR BILGE VALVES, TEST RUN FIRE
PUMPS DIESEL 7-2-69

Signature

Electrician

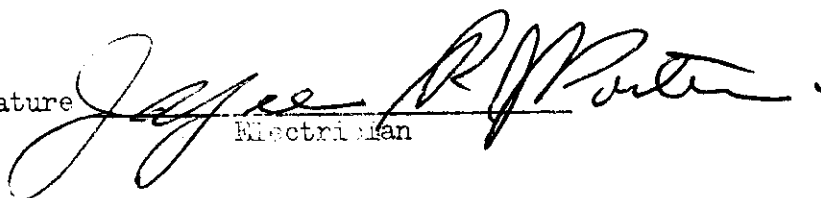

30 JUN TO 3 JUL

USNS GEN WEIGEL

DATE _____

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DE-ICING	30 th	4	COLD 500K F.I. 7M F.P. 1.5M HOT 75K F.I. 15M F.P. 1M
CARGO WINCHES	3 rd	1/4	#1-10M #2-300K
ANCHOR WINDLASS	2 nd		4M.
CAPSTAN	2 nd		#1-20M #2-30M
FIRE ALARMS	Daily		
ENGINE BATTERIES			CHARGED 3 DAYS AFTER 1220 BLACKOUT
DIESEL BATTERIES	30 th		OK. 1240
FIRE PUMP BATTERIES			
DIESEL GENERATORS			NOT WORKING
LAUNDRY SUPPLY	3 rd	1hr	
RECTIFIERS	Daily		

302-108-3 3M. KS PULLED

302-108-4 700K FLDS ENRG.

302-140-1 900K FLDS ENRG.

302-140-2 1.5 KS PULLED.

Signature

Electrician

Arthur B. B. Harrell

USNS GEN

WEIGEL

DATE

JUNE
23-27-196ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	23 rd	4	COLD M 400K FI 3H 7P.14 HOT M 25K FI 25H 7P.14
CARGO WINCHES	27	$\frac{1}{7}$	COLD #1 #2 HOT #1 #2
ANCHOR WINDLASS	25	1	COLD #1.4M HOT #1.400K.
CAPSTAN	25	1	COLD #1.50M. #2.50M. HOT #1.50M. #2.90M.
FIRE ALARMS	DAILY		
EMERG. BATTERIES	23 rd		OK - 1.240
DIESEL BATTERIES	23 rd		1240 ON CHARGE THUR-FRI 24 th -25 th
FIRE PUMP BATTERIES	—		
DIESEL GENERATORS		1	
LAUNDRY SUPPLY		1	COLD T1.25K T11.3M HOT T1.40K T11.25M.
RECTIFIERS	DAILY		

Signature

Archie R. O. Garrett

Electrician


USNS GEN POPE (TAP 110)DATE 28 June 1969ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	6-23-69	4 HRS	2 MEGGS
CARGO WINCHES	6-27-69	1 HR	#5-4 MEGGS #6-6 MEGGS
ANCHOR WINDLASS	6-25-69	1 HR	8 MEGGS
CAPSTAN	6-25-69	1 HR	#1-5 MEGGS #2-20 MEGGS
FIRE ALARMS	DAILY		
EMERG. BATTERIES	6-23-69	OK	
DIESEL BATTERIES	6-23-69	OK	
FIRE PUMP BATTERIES	6-23-69	OK	
DIESEL GENERATORS	6-25-69	2 HRS	6 MEGGS
LAUNDRY SUPPLY	WEIGEL ONLY		
RECTIFIERS	DAILY		

TESTED ALL BILGE AIR VALVES 6-25-69

TEST RUN EMERG FIRE PUMPS DIESEL #1 & 2 - 6-25-69

Signature

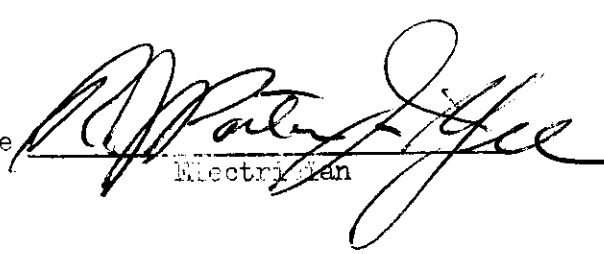
Electrician

USNS GEN John Pope (TAP110)DATE 16 June 1969ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	6-16-69	4 HRS	2 MEGGS
CARGO WINCHES	6-20-69	1 HR	#5-7 MEGGS #6-6 MEGGS
ANCHOR WINDLASS	6-18-69	1 HR	6 MEGGS
CAPSTAN	6-18-69	1 HR	#1-1 MEGGS #2-5 MEGGS
FIRE ALARMS	DAILEY		
EMERG. BATTERIES	6-16-69	OK	
DIESEL BATTERIES	6-16-69	OK	
FIRE PUMP BATTERIES	6-16-69	OK	
DIESEL GENERATORS	6-18-69	1/2 HR	6 MEGGS
LAUNDRY SUPPLY	WEIGEL ONLY		
RECTIFIERS	DAILEY		

TESTED ALL BILGE AIR VALVES, TEST RUN # 1 & 2
DIESEL EMERG. FIRE PUMPS. 6-18-69

Signature


Electrician

USNS GEN

WEIGEL

DATE

6-16-2069ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING	
DEGAUSSING	6/16	4	COLD M 300K F I 50M F T M.	
			HOT M 100K F I 50M F P 500K	
CABLE WINCHES	6/20	1	COLD #1 9M #2 6M	
			HOT #1 200K #2 200K	
ANCHOR WINDLASS	1814	1	COLD #1 3M	
			HOT #1 800K	
CAPSTAN	6/18	1	COLD #1 40M #2 40M	
			HOT #1 30K #2 25M	
FIRE ALARMS	DAILY			
EMERG. BATTERIES	6/16		1250	
DIESEL BATTERIES	6/16		1250	
PUMP BATTERIES				
DIESEL GENERATORS	1814	1/2		
LAUNDRY SUPPLY	6/18	2	COLD T 7 25K T 11 150K	
			HOT T 7 1M T 11 15M	
RECTIFIERS	DAILY			
S-02-108-3	6/19		600K	F L D S E N E R G I Z E D
S-02-108-4	6/19		300K	" "
S-02-140-1	6/19		1M.	SW PULLED
S-02-140-2	6/19		200K.	F L D S E N E R G I Z E D

Signature

Arthur B. C. Garrett
Electrician

USNS GEN

WeigelDATE 6-13-69ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING	
			HOT	COLD
DEGAUSSING	9	4	M 300K FI 2M FP 1M	M 100K FI 1M FP 800K
CABLE WINCHES	13 th	1/4	#1 - 2 Megs.	#2 - 200K
ANCHOR WINDLASS	11 th	1	Cold. 4M.	Hot. 300K
CAPSTAN	11 th	1	#1 - 75M	#2 - 40M
FIRE ALARMS	Daily		OK 1.240	
EMER. BATTERIES	9 th		OK 1.240	
DIESEL BATTERIES	9 th		low-charged to 1260	
FIRE PUMP BATTERIES				
DIESEL GENERATORS	11 th	1/2	NO LOAD.	
LAUNDRY SUPPLY	11 th	1	Lo. 200K	Hi. 200K
RECTIFIERS	Daily			

Signature

W. C. Brooks.

Electrician

USNS GEN POPE (TAP 110)DATE 9 June 1969ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	9 June 69	4 HRS.	2 MEGGS.
CARGO WINCHES	6-13-69	1 HR	#5-2 MEGGS #6-6 MEGGS.
ANCHOR WINDLASS	6-11-69	1/2 HR	6 - MEGGS
CAPSTAN	6-11-69	1/2 HR	#1-2 MEGGS #2 MEGGS 15
FIRE ALARMS	DAILY		
EMER. BATTERIES	6-9-69	OK	
DIESEL BATTERIES	6-9-69	OK	
FIRE PUMP BATTERIES	6-9-69	OK	
DIESEL GENERATORS	6-11-69	1/2 HR.	6 MEGGS
LAUNDRY SUPPLY	WEIGEL ONLY		
RECTIFIERS	DAILY		

TESTED DUGE AIR VALVES 6-11-69

TEST RUN #1 & 2 FIRE PUMPS (DIESEL) 6-11-69.

Signature

Electrician

USNS GEN JOHN PIPE (TAP-110)

DATE 2 June 1869

ROUTINE WEEKLY AND DAILY TEST FOR ELECTRICIANS

UNIT	DATE	HRS	MEGGER READING
DEGAUSSING	6-2-69	4 Hrs.	2 MEGGS
CARGO WINCHES	6-6-69	1 HR	#5-2 MEGGS #6-6 MEGGS
ANCHOR WINDLASS	6-4-69	1 HR	8 MEGGS
CAPSTAN	6-4-69	1 HR	#1-2 MEGGS #2-15 MEGGS
FIRE ALARMS	DAILY		
EMERG. BATTERIES	6-2-69	OK	
DIESEL BATTERIES	6-2-69	OK	
FIRE PUMP BATTERIES	6-2-69	OK	
DIESEL GENERATORS	6-4-69	1/2 Hr.	6 MEGGS
LAUNDRY SUPPLY	WEIGEL ONLY		
RECTIFIERS	DAILY		

TESTED ALL BIGGE AIR VALVES - 6-4-69

TESTED # 1 & 2 DIESEL FIRE PUMPS.

Signature

Electrician